


# FLP-25-T1-V/4

## SPD - for low voltage / SPD type 1 / Combination type - T1 (25 kA)

Lightning current arrester for 3-phase TN-S system

pluggable module, visual fault signalling, module locking

- four-pole high performance lightning current arrester, leakage current-free
- installation at the boundary of zones LPZ 0 and LPZ 1 or higher, mainly to main distribution boards
- for protection against impact of direct or indirect lightning strikes in wide range of applications – houses, office and industrial buildings
- coordination with SPD type 2 (SLP-275 V) even without surge separating inductors

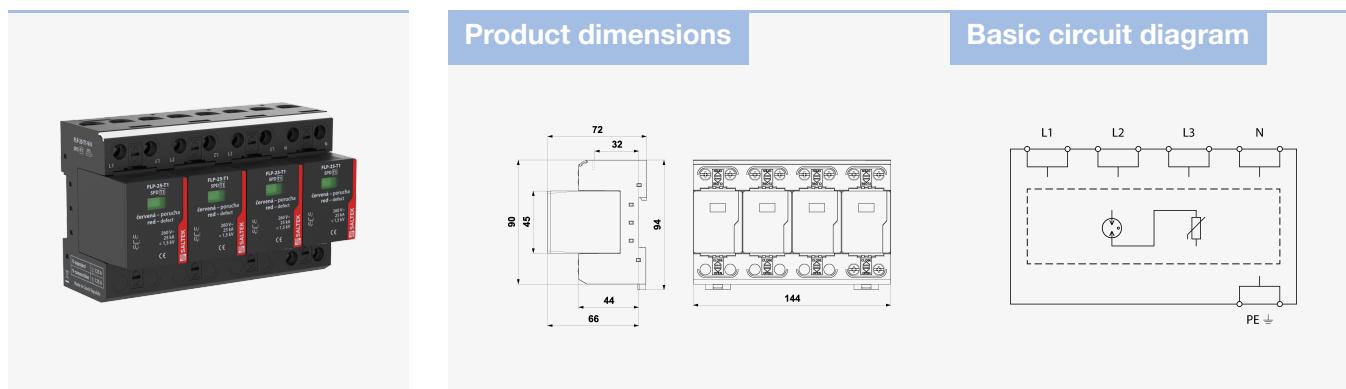

Parameter name	Parameter value
Type of SPD	T1
Mounting	DIN rail 35 mm
Nominal voltage	$U_n$ 230 V AC
Maximum operating voltage	$U_c$ 260.00 V AC
Nominal load current for "V" connection	$I_L$ 125 A
Type of network	TN
Maximum overcurrent protection	250 A gL/gG
Maximum overcurrent protection for "V" connection	125 A gL/gG
Short-circuit current rating	$I_{SCCR}$ 50.0 kA
Total discharge current (10/350 $\mu$ s)	$I_{Total(10/350)}$ 100.00 kA
Lightning impulse current (10/350 $\mu$ s)	$I_{imp}$ 25.00 kA
Voltage protection level	$U_p$ 1.50 kV
Response time	$t_a$ 100 ns
TOV 5 s L-N	335 V

TOV characteristic (TOV 5 s)	withstand
Cross-section of connected conductors solid (min)	2.50 mm <sup>2</sup>
Cross-section of connected conductors solid (max)	50.00 mm <sup>2</sup>
Cross-section of connected conductors stranded (min)	2.50 mm <sup>2</sup>
Cross-section of connected conductors stranded (max)	35.00 mm <sup>2</sup>
Fault indication	red indication field
Degree of protection	IP 20
Range of ambient temperatures (min/max)	-40 / 80 °C
Humidity	5 - 95 %
According to standard	EN 61643-11:2012, IEC 61643-11:2011
ETIM Class	EC000381
Plug module	FLP-25-T1-V/0
Customs tariff number	85363090
EAN	8595090553021
Order number	A05302

SALTEK s.r.o., Dráždanská 561/85, 400 07 Ústí nad Labem, CZ | +420 475 655 511 | [info@saltek.cz](mailto:info@saltek.cz) | [www.saltek.eu](http://www.saltek.eu)

Technická podpora: 800 818 818 | [podpora@saltek.cz](mailto:podpora@saltek.cz)

22.07.2025 -  
22:34:17